



February 13, 2020

Utelite Corporation
6375 Three Mile Canyon Road,
Coalville, UT 84017

Attention: Mr. Jeff Barrick

Subject: Qualifications Testing of Utelite Structural Fine Lightweight Aggregate


Dear: Mr. Jeff Barrick

Kleinfelder has performed testing, per your request, to verify the conformance of Utelite Structural Fine Lightweight Aggregate with ASTM C330-17 "Standard Specification for Lightweight Aggregates for Structural Concrete".

Upon review of the results, the Utelite Structural Fine Lightweight Aggregates meet C330-17 test requirements for the Calendar Year 2020.

See the following results.

Sincerely,

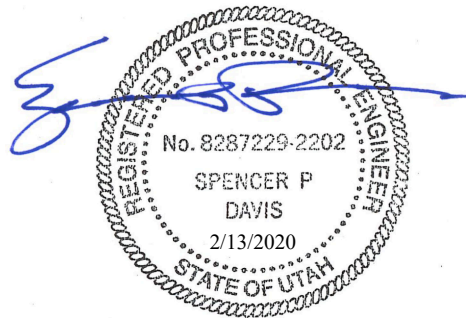

Spencer Davis, PE
Principal Geotechnical Engineer

849 West Levoy Drive, Suite 200
Salt Lake City, UT, 84123
o| (1) 801.261.3336
d| (1) 801.713.2870
m| (1) 435.512.0580
f| (1) 801.261.3306

Fine Aggregates

SIEVE ANALYSIS		
Sieve Size (ASTM C136)	Accum. % Passing	Specifications
9.5 mm (3/8")	100	100
4.75mm (No. 4)	99	85-100
2.36 mm (No. 8)	87	---
2.00 mm (No. 10)	80	---
1.18mm (No. 16)	58	40-80
0.600 mm (No. 30)	37	---
0.425mm (No. 40)	29	---
0.300mm (No. 50)	24	10-35
0.150mm (No. 100)	17	5-25
0.075mm (No. 200)	11.8	---

TEST RESULTS				
Standard	CHEMICAL and PHYSICAL PROPERTIES		Results	Specification
ASTM C40	Organic Impurities	Color Comparison=	Lighter than Standard	Lighter than Standard
ASTM C641	Staining Index	Stain Index=	20	20
ASTM C114	Loss on Ignition	Loss, %=	0.30	Less Than 5 Percent
ASTM C142	Clay Lumps and Friable Particles	Fine Aggregate, %=	0.60	Less than 2 Percent
ASTM C29	Bulk Density: Dry Loose Condition	Unit Weight, lbs./cu.ft=	59.5	70 PCF Maximum
ASTM C29	Bulk Density: Saturated Loose Condition	Unit Weight, lbs./cu.ft=	69.8	No Requirement
ASTM C1761	Absorption of Lightweight Fine Aggregate	*Absorption, %=	17.4	No Requirement
ASTM C127/128	Relative Density of Fine Aggregate (SSD)	Relative Density, (SSD)=	1.813	No Requirement
ASTM C88	Soundness of Aggregtes (Sodium Sulfate)	Fine Soundness Loss, %=	3.0	Less than 10 Percent
ASTM C88	Soundness of Aggregates (Magnesium)	Fine Soundness Loss, %=	3.9	Less than 15 Percent

*Absorption is calculated using a minimum soak time of 72-hours