



January 12, 2021

Utelite Corporation
6375 Three Mile Canyon Road,
Coalville, UT 84017

Attention: Mr. Jeff Barrick

Subject: Qualifications Testing of Utelite Structural Blend Lightweight Aggregate



Dear: Mr. Jeff Barrick

Kleinfelder has performed testing, per your request, to verify the conformance of Utelite Structural Blend Lightweight Aggregate with ASTM C330-17 "Standard Specification for Lightweight Aggregates for Structural Concrete".

Upon review of the results, the Utelite Structural Blend Lightweight Aggregates meet C330-17 test requirements for the Calendar Year 2021.

See the following results.

Sincerely,

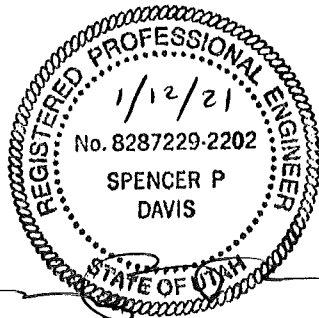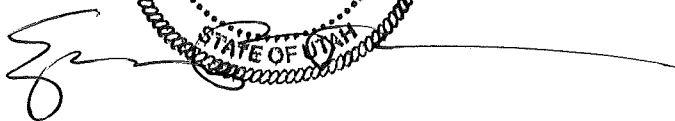

Spencer Davis, PE
Principal Geotechnical Engineer

849 West Levoy Drive, Suite 200
Salt Lake City, UT, 84123
o| (1) 801.261.3336
d| (1) 801.713.2870
m| (1) 435.512.0580
f| (1) 801.261.3306

SIEVE ANALYSIS		
ASTM C136	AASHTO T27	
Sieve Size	Accum. % Passing	Specifications
12.5 mm (1/2")	100	100
9.5 mm (3/8")	97	90-100
4.75mm (No. 4)	80	65-90
2.36 mm (No. 8)	60	35-65
2.00 mm (No. 10)	55	---
1.18mm (No.16)	40	---
0.600 mm (No.30)	23	---
0.425mm (No. 40)	15	---
0.300mm (No. 50)	10	10-25
0.150mm (No.100)	7	5-15
0.075mm (No. 200)	5.5	0-10

TEST RESULTS			
Standard	CHEMICAL and PHYSICAL PROPERTIES	Results	Specification
ASTM C40	Organic Impurities	Color Comparison=	Lighter than Standard Lighter than Standard
ASTM C641	Staining Index	Stain Index=	20 Less than 60
ASTM C114	Loss on Ignition	Loss, %=	0.28 Less Than 5 Percent
ASTM C142	Clay Lumps and Friable Particles	Fine Aggregate, %=	0.20 Less than 2 Percent
ASTM C29	Bulk Density: Dry Loose Condition	Unit Weight, lbs./cu.ft=	63.0 65 PCF Maximum
ASTM C29	Bulk Density: Saturated Loose Condition	Unit Weight, lbs./cu.ft=	73.0 No Requirement
ASTM C1761	Absorption of Lightweight Fine Aggregate	*Absorption, %=	15.4 No Requirement
ASTM C127/128	Relative Density of Fine Aggregate (SSD)	Relative Density, (SSD)=	1.840 No Requirement
ASTM C88	Soundness of Aggregtes (Sodium Sulfate)	Soundness Loss, %=	4.1 Less than 12 Percent
ASTM C88	Soundness of Aggregates (Magnesium)	Soundness Loss, %=	5.2 Less than 18 Percent
ASTM C39	Compressive Strength	Average Strength, psi=	5200 4,000 PSI Minimum
ASTM C496	Splitting Tensile Strength	Average Strength, psi=	370 330 PSI Minimum
ASTM C567	Fresh Concrete Density	Density, lbs./cu.ft=	118.2 No Requirement
ASTM C567	Oven Dry Density	Density, lbs./cu.ft=	109.6 No Requirement
ASTM C567	Approximate Equilibrium Density	Density, lbs./cu.ft=	112.2 No Requirement
ASTM C157	Drying Shrinkage	Shrinkage, %=	0.05 Less than 0.07
ASTM C151	Popouts	Popouts=	None No Popouts
ASTM C1260	Potential Alkali Reactivity of Aggregates	Reactivity, %=	0.06 Less than 0.10

*Absorption is calculated using a minimum soak time of 72-hours